



中国认可
国际互认
检测
TESTING
CNAS L0187

检测报告

Inspection Report

证书编号: RA25S-GS01310927

Certificate number



样品名称
Device name

洁净室

委托单位
The entrusted unit

长城电器集团山东有限公司

检测类别
Inspection category

委托检测

委托日期
Commission date

2025年09月18日

北京市计量检测科学研究院

Beijing institute of metrology and testing science

检测专用章

(3)

检测信息表

产品名称 Device name	洁净室	规格型号 Specification and Model	--		
委托方 The delegate	长城电器集团山东有限公司				
委托方地址 Add	山东省济南市高新区临港街道临港路 5557 号				
委托单号 Order number	W2501310927	接收日期 Date of acceptance	2025-09-18	检测日期 Inspection date	2025-09-19
检验类别 Inspection category	委托检测	商标 Trademark	--		
取样方式 Sampling method	现场监测				
检验依据 Test basis	GB 50591-2010 《洁净室施工及验收规范》				
样品说明	外观无破损，符合试验要求				
签发日期:		2025-09-30			

批准: 董物理

审核: 张大鹏




检测结果表

证书编号：RA25S-GS01310927

填报日期：2025-09-30

序号 Series Number	检测项目 Tests Items	技术要求 Requirement	单位 Unit	检测结果 Test Results	单项结论 Item conclusion	备注 Remarks	
1	净化车间 (十万级)	温度	20~22	℃	20.8	合格	--
2		湿度	30~50	%	45	合格	--
3		压差	≥5	Pa	8	合格	--
4		照度	200~300	Lx	263	合格	--
5		悬浮粒子 (≥0.5 μm)	≤352000	个/m ³	285023	合格	--
6		悬浮粒子 (≥5 μm)	≤2930	个/m ³	2081	合格	--
7		浮游菌	≤500	个/m ³	65	合格	--
8		沉降菌	≤10	个/皿	5.2	合格	--
9		换气数	≥15	次/小时	17	合格	--
-报告结束-							

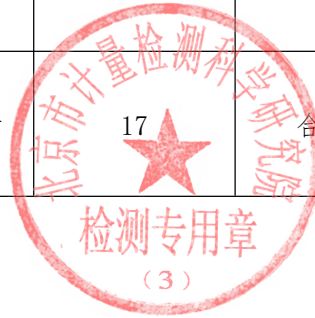


检测结果表

证书编号: RA25S-GS01310927

填报日期: 2025-09-30

净化车间布局图

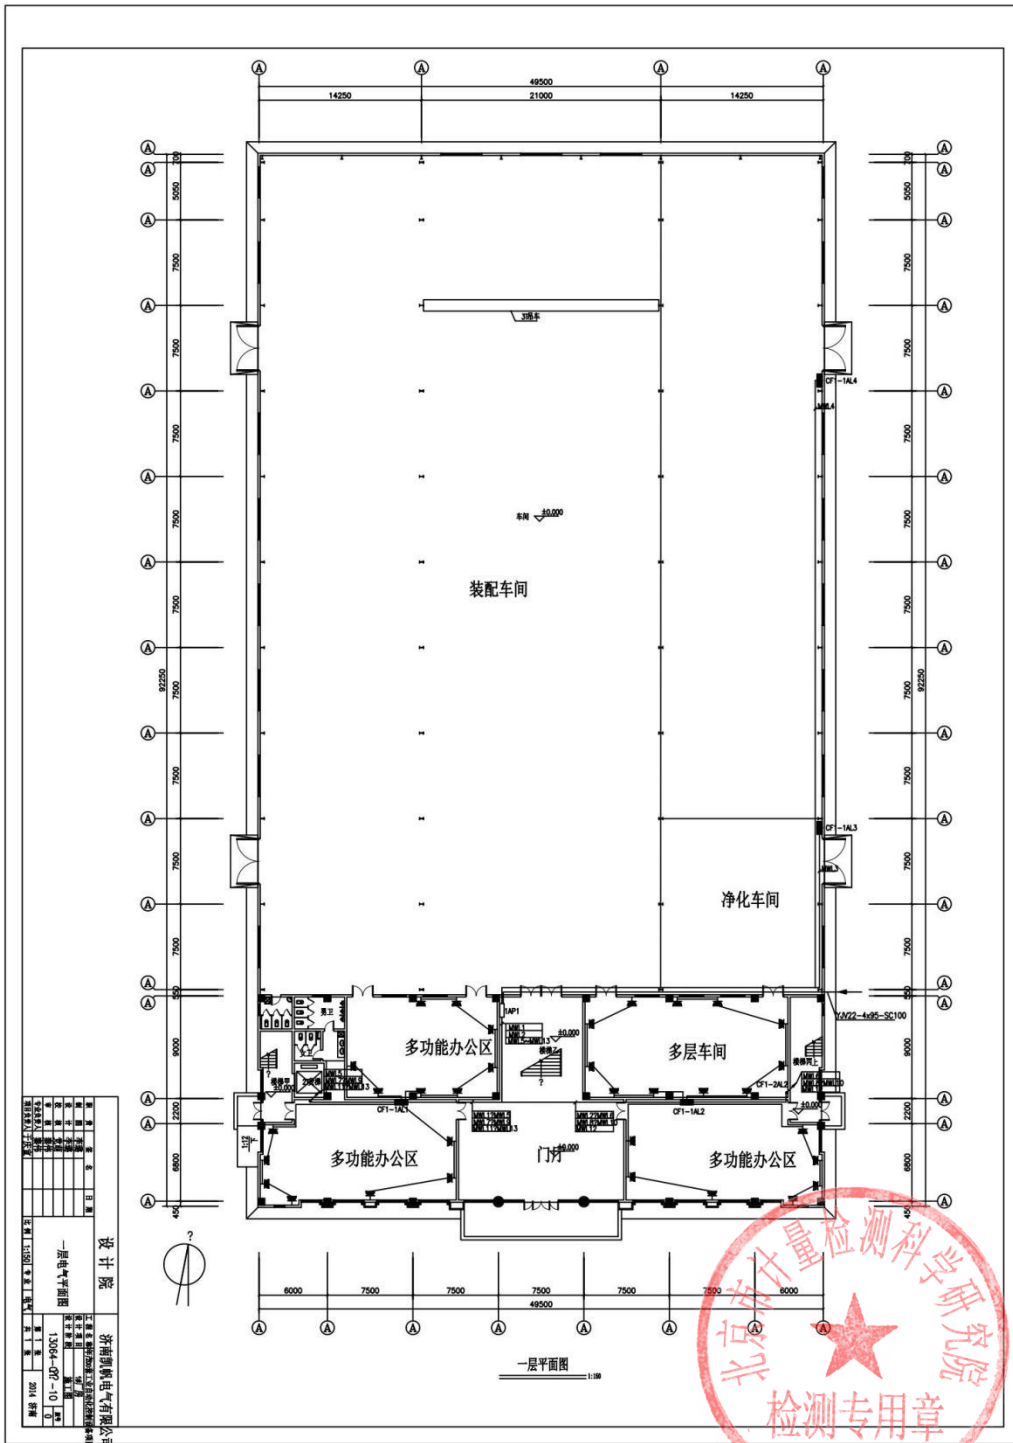

说 明

Notice

1、本报告无“检验专用章”和骑缝章无效。

This test report is invalid without the seal.

2、本报告无“主检、审核、批准”签字无效。

This test report is invalid without the signatures of the related persons.

3、本报告涂改、部分复印无效。

This test report is invalid if erased, altered or copied partially.

4、对本报告若有异议，应于收到报告之日起十五日内向本单位提出，逾期不予受理。

Any doubt should inform us within 15 days after receiving the test report.

5、委托检验样品和委托信息人由委托人提供，本单位不对其真实性负责，委托检验结果仅对来样负责。

The commissioned testing samples and commission information are provided by the applicant, the results shown in the test report refer only to the sample(s) tested unless otherwise stated. Identifying authenticity of the supplied samples and information is out of our responsibility.

